



NOTES

1. Paint pipe threads with asphalt paint after assembly.
2. All piping to be galvanized steel.
3. Valve and piping to valve to be 50 mm unless otherwise noted on plan.
4. Locate blowoff outlet near property corner if possible.

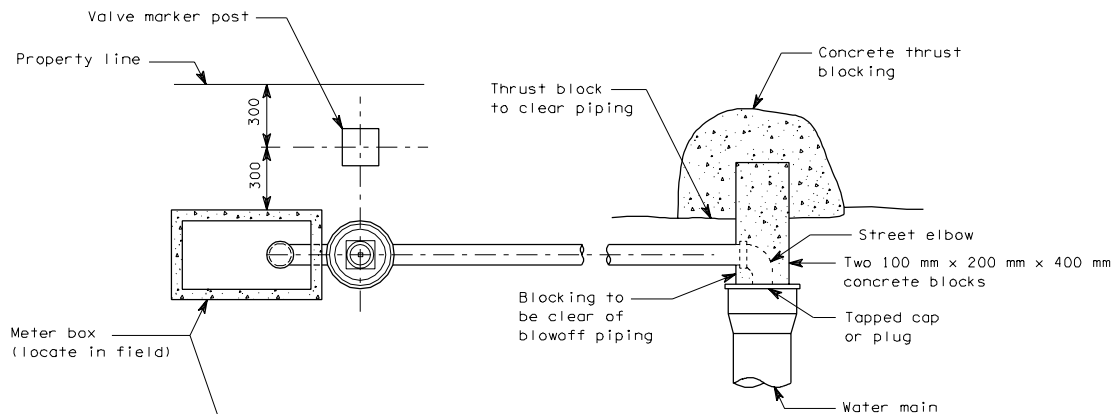

PLAN

50 mm Female x IP x 65 mm male NST hose connection with cap

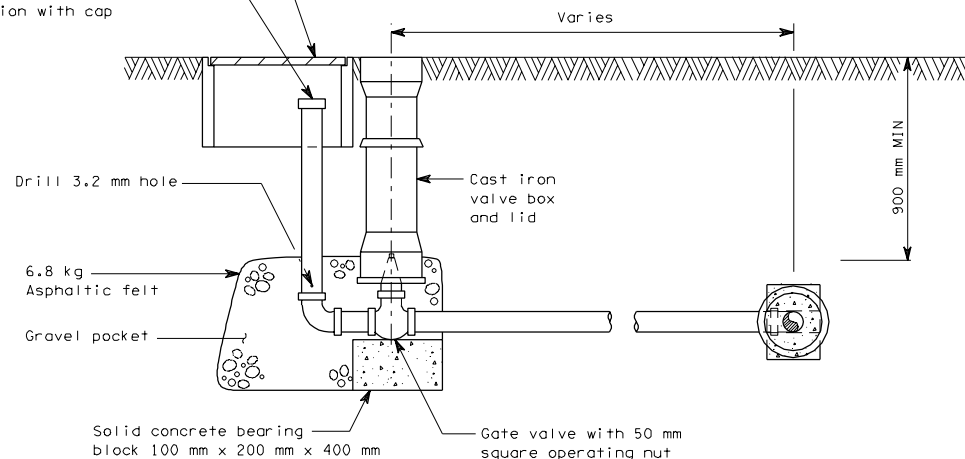

ELEVATION

ALL DIMENSIONS ARE IN MILLIMETERS
UNLESS OTHERWISE NOTED

50 mm BLOWOFF ASSEMBLY

STANDARD PLAN B-21

APPROVED FOR PUBLICATION

STATE DESIGN ENGINEER

DATE

WASHINGTON STATE DEPARTMENT OF TRANSPORTATION
OLYMPIA, WASHINGTON

